

BOLLY® 2 ST

POLYWARM® COATED DOMESTIC HOT WATER CALORIFIER WITH 2 FIXED HEAT EXCHANGERS



APPLICATION

Production and storage of domestic hot water.

MATERIAL

Mild steel Polywarm® coated (Attestation ACS - SSICA - DVGW - W270 - UBA - WRAS)

HEAT EXCHANGER

2 Polywarm® coated fixed heat exchangers.

INSULATION

- HARD: High thermal insulation with ecological polyurethane hard foam.
- SOFT: NOFIRE® polyester fleece 100% made of recyclable material, with high thermal insulation. Fire resistance class B-s2d0 according to EN 13501.

Grey PVC external lining complete with top and flange cover

CATHODE PROTECTION

Magnesium anode.

DRAIN

External confluence through drain connection.

Models > 500 external confluence through drain pipe.

GASKET- FLANGE PLATE

Silicone gaskets suitable for alimentary use for max temperature up to 200°C. Mild steel inspection flange plate with Polywarm®

WARRANTY


5 years - See general sales conditions and warranty

ACCESSORIES AND SPARE PARTS :

See Accessories section for the entire list.




HARD FOAM INSULATION



www.cordivari.com/erp

On line ErP label tool

SOFT FLEECE INSULATION



BOLLY® 2 ST WB

HEAT EXCHANGER SURFACE

ENERGY EFFICIENCY CLASS

| Model | HARD FOAM insulation Art. Nr. | HEAT EXCHANGER SURFACE | | ENERGY EFFICIENCY CLASS |
|-------|----------------------------------|------------------------|-------|-------------------------|
| | | Upper | Lower | |
| | | [m ²] | | |
| 150 | 3135162321201 | 0,4 | 0,6 | B |
| 200 | 3135162321202 | 0,5 | 0,8 | B |
| 300 | 3135162321203 | 0,7 | 1,2 | C |
| 400 | 3135162321204 | 1 | 1,5 | C |
| 500 | 3135162321205 | 1 | 1,8 | C |
| 800 | 3134162331206 | 1,6 | 2,7 | C |
| 1000 | 3134162331207 | 1,8 | 3,5 | C |
| 1500 | 3134162331208 | 1,9 | 3,8 | C |

BOLLY® 2 ST WC

HEAT EXCHANGER SURFACE

ENERGY EFFICIENCY CLASS

| Model | DISMOUNTABLE SOFT FLEECE insulation Art. Nr. | HEAT EXCHANGER SURFACE | | ENERGY EFFICIENCY CLASS |
|-------|-------------------------------------------------|------------------------|-------|-------------------------|
| | | Upper | Lower | |
| | | [m ²] | | |
| 800 | 3138162321226 | 1,6 | 2,7 | C |
| 1000 | 3138162321227 | 1,8 | 3,5 | C |
| 1500 | 3138162321228 | 1,9 | 3,8 | C |

ELECTRICAL IMMERSION HEATERS

| Mod. | Volume of water heated by the electrical immersion [lit] | MONOPHASE | | |
|------|----------------------------------------------------------|---------------|---------------|---------------|
| | | 1,5 kW | 2 kW | 3 kW |
| 150 | 42 | 5240000000051 | 5240000000052 | 5240000000053 |
| 200 | 72 | | | |
| 300 | 113 | | | |
| 400 | 167 | | | |
| 500 | 184 | | | |
| 800 | 313 | | | |
| 1000 | 383 | | | |
| 1500 | 557 | | | |

| MONOPHASE | | | |
|----------------------------------------------------------------|------|------|--|
| 1,5 kW | 2 kW | 3 kW | |
| Ignition time from 10 °C to 45 °C with immersion heaters [min] | | | |
| 76 | 57 | 38 | |
| 128 | 96 | 64 | |
| 202 | 152 | 101 | |
| 299 | 225 | 150 | |
| 329 | 247 | 165 | |
| 560 | 420 | 280 | |
| 686 | 514 | 343 | |
| 998 | 749 | 499 | |

| THREEPHASE | | | | |
|----------------------------------------------------------------|---------------|---------------|---------------|---------------|
| 4 kW | 5 kW | 6 kW | 9 kW | 12 kW |
| Ignition time from 10 °C to 45 °C with immersion heaters [min] | | | | |
| 5240000000047 | 5240000000048 | 5240000000049 | 5240000000050 | 5240000000031 |
| // | // | // | // | // |
| // | // | // | // | // |
| // | // | // | // | // |
| // | // | // | // | // |
| 257 | 206 | 171 | 114 | 86 |
| 374 | 299 | 250 | 166 | 125 |

Accessories on request

"Easy Control" Electronic Display

| ART. NR. | FOR MODELS |
|---------------|------------|
| 5005000310002 | WC |
| 5005000310003 | WB |



Electrical immersion flange plate

See Accessories section



Titanium electronic anode

See Accessories section





BOLLY® 2 ST



POLYWARM® COATED DOMESTIC HOT WATER CALORIFIER WITH 2 FIXED HEAT EXCHANGERS

| Model | STORAGE | | HEAT EXCHANGER | | |
|-------------|---------|-------|----------------|--------|--|
| | Pmax | Tmax | Pmax | Tmax | |
| 150 ÷ 800 | 10 bar | 90 °C | 12 bar | 110 °C | |
| 1000 ÷ 1500 | 8 bar | | | | |


CORDIVARI Lab
TÜV Rheinland Energie und Umwelt GmbH states that test procedures and Cordivari LAB are certified conforming to European standard EN 15332, as indicated by Ecodesign ErP Directive.

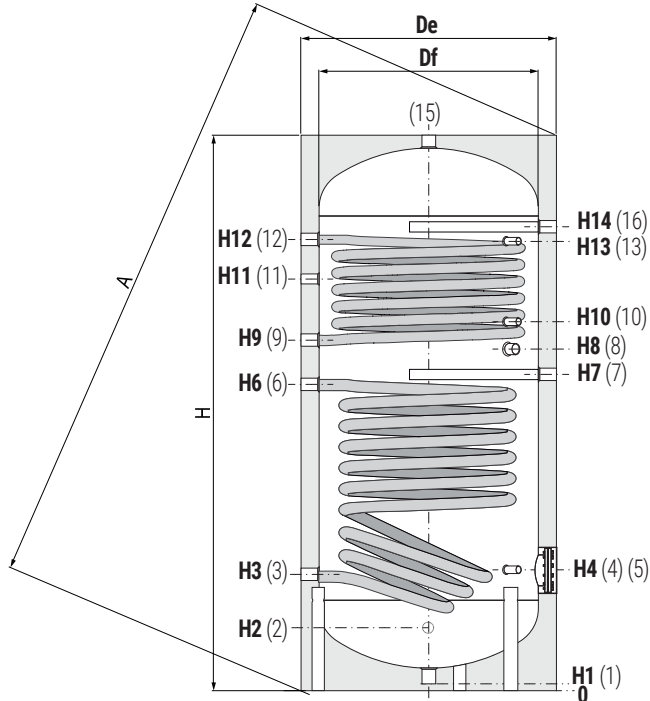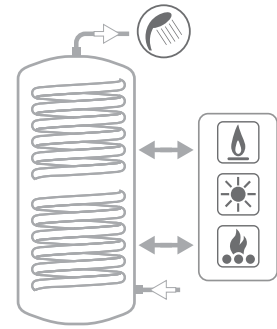

- | | |
|----|--------------------------------------------------------------------------|
| 1 | Drain 1"1/4 Gas F (3/4"su 800 e 1000.) (1" su 1500) |
| 2 | Domestic cold water circuit inlet |
| 3 | Lower heat exchanger outlet |
| 4 | Connection for instrumentation 1/2" Gas F |
| 5 | Blind flange for inspection |
| 6 | Lower heat exchanger inlet |
| 7 | Connection for magnesium anode 1"1/4 Gas F |
| 8 | Connection for electrical immersion |
| 9 | Upper heat exchanger outlet |
| 10 | Connection for instrumentation 1/2" Gas F |
| 11 | Recirculation |
| 12 | Upper heat exchanger inlet |
| 13 | Connection for instrumentation 1/2" Gas F |
| 15 | Domestic hot water outlet |
| 16 | Connection for 2 nd anode 1"1/4 Gas F (only for models > 500) |

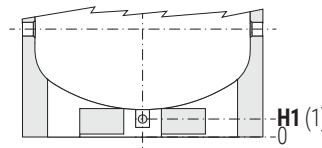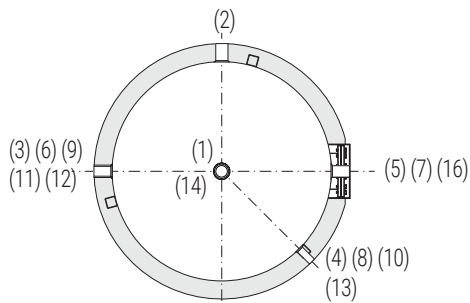

Models 1500 have two grips on the bottom which allow the use of forklift when handling and drain pipe already fitted.

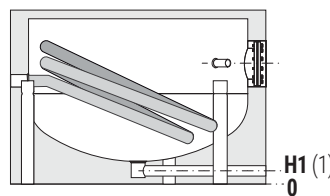

P.E.D. product designed and produced in conformity to the article 4.3 of directive 2014/68/UE - ErP Ecodesign directive 2009/125/CE


| Model | Volume [litres] | Weight [Kg] | Df | De | De (vers. WB) | H | A | H1 | H2 | H3 | H4 | H6 | H7 |
|-------|-----------------|-------------|------------|------------|---------------|------|------|-----|-----|-----|-----|------|------|
| | | | (vers. WC) | (vers. WC) | | | | | | | | | |
| 150 | 148 | 54 | // | // | 500 | 1414 | 1500 | 70 | 210 | 275 | 315 | 759 | 815 |
| 200 | 189 | 65 | // | // | 550 | 1434 | 1536 | 70 | 220 | 285 | 325 | 811 | 855 |
| 300 | 291 | 83 | // | // | 650 | 1486 | 1622 | 70 | 246 | 311 | 381 | 832 | 871 |
| 400 | 422 | 112 | // | // | 700 | 1766 | 1900 | 70 | 261 | 326 | 396 | 988 | 1033 |
| 500 | 498 | 134 | // | // | 750 | 1786 | 1937 | 70 | 271 | 346 | 411 | 1036 | 1076 |
| 800 | 789 | 232 | 750 | 950 | 900 | 2163 | 2343 | 101 | 493 | 428 | 483 | 1181 | 1243 |
| 1000 | 1038 | 272 | 850 | 1050 | 1000 | 2217 | 2432 | 89 | 524 | 439 | 499 | 1279 | 1309 |
| 1500 | 1443 | 351 | 950 | 1150 | 1100 | 2440 | 2654 | 109 | 450 | 425 | 575 | 1403 | 1450 |

| Model | H8 | H9 | H10 | H11 | H12 | H13 | H14 | 5 | 1 | 2 | 3-6 9-12 | 8 | 11 | 15 |
|-------|------|------|------|------|------|------|------|-------|-------|-------|-------------|----|------|-------|
| | [mm] | | | | | | | | | | | | | |
| 150 | 885 | 945 | 1035 | 1065 | 1185 | 1185 | // | Ø 120 | 1"1/4 | 3/4" | 1"1/4 | 1" | 3/4" | 1"1/4 |
| 200 | 915 | 960 | 1105 | 1089 | 1195 | 1195 | // | Ø 120 | 1"1/4 | 3/4" | 1"1/4 | 1" | 3/4" | 1"1/4 |
| 300 | 931 | 981 | 1076 | 1101 | 1221 | 1221 | // | Ø 120 | 1"1/4 | 1" | 1"1/4 | 1" | 1" | 1"1/4 |
| 400 | 1091 | 1143 | 1286 | 1286 | 1486 | 1486 | // | Ø 120 | 1"1/4 | 1" | 1"1/4 | 1" | 1" | 1"1/4 |
| 500 | 1144 | 1186 | 1296 | 1331 | 1476 | 1476 | // | Ø 120 | 1"1/4 | 1" | 1"1/4 | 1" | 1" | 1"1/4 |
| 800 | 1308 | 1362 | 1579 | 1598 | 1770 | 1788 | 1808 | Ø 160 | 3/4" | 1" | 1"1/4 | 2" | 1" | 1"1/4 |
| 1000 | 1364 | 1399 | 1609 | 1584 | 1819 | 1819 | 1839 | Ø 160 | 3/4" | 1"1/4 | 1"1/4 | 2" | 1" | 1"1/2 |
| 1500 | 1515 | 1550 | 2045 | 1825 | 2065 | 1735 | 2065 | Ø 300 | 1" | 1"1/2 | 1"1/4 | 2" | 1" | 2" |

BOLLY® 2 ST- HEAT EXCHANGERS TECHNICAL DATA


Data have been calculated on following basis:

- 1) Primary circuit at T1 and proper energy source;
- 2) Production of DHW in continue way from 10 °C at t2;
- 3) DHW that can be taken in the first 10' and in the first hour from storage at 60°C, input 10°C and output 45°C;
- 4) Sanitary water according to UNI CTI 8065.

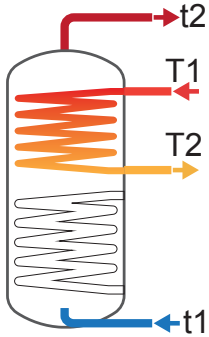

UPPER FIXED HEAT EXCHANGER

| Model | Ignition time (minutes) from 10 °C to t2 and primary at T1 | | | | Maximum power exchange (kW) with primary at T1, secondary within 10-45 °C and constant use of DHW production | | | | DHW continuous production lt/h within 10-45 °C and primary at T1 | | | |
|-------|------------------------------------------------------------|-------|-------|-------|--------------------------------------------------------------------------------------------------------------|------|------|------|------------------------------------------------------------------|-----|------|------|
| | T1/t2 | | | | T1 | | | | T1 | | | |
| | 55/50 | 65/60 | 70/60 | 80/60 | 55 | 65 | 70 | 80 | 55 | 65 | 70 | 80 |
| 150 | 47 | 49 | 34 | 22 | 4,5 | 6,8 | 7,9 | 10,3 | 109 | 165 | 194 | 254 |
| | 52 | 64 | 38 | 24 | 4,1 | 6,2 | 7,2 | 9,4 | 100 | 151 | 177 | 231 |
| 200 | 46 | 48 | 33 | 21 | 5,7 | 8,6 | 10 | 13,1 | 138 | 210 | 247 | 322 |
| | 51 | 53 | 37 | 24 | 5,3 | 7,9 | 9,3 | 12 | 129 | 194 | 227 | 296 |
| 300 | 51 | 53 | 37 | 24 | 8 | 12,1 | 14,1 | 18,4 | 195 | 296 | 347 | 453 |
| | 57 | 59 | 41 | 27 | 7,5 | 11,2 | 13,1 | 16,9 | 183 | 274 | 321 | 416 |
| 400 | 55 | 57 | 40 | 26 | 11,4 | 17,2 | 20,2 | 26,2 | 279 | 423 | 496 | 646 |
| | 61 | 63 | 44 | 29 | 10,7 | 16 | 18,6 | 24 | 262 | 392 | 458 | 592 |
| 500 | 61 | 64 | 44 | 29 | 11,4 | 17,2 | 20,2 | 26,2 | 279 | 423 | 496 | 646 |
| | 68 | 70 | 49 | 32 | 10,7 | 16 | 18,6 | 24 | 262 | 392 | 458 | 592 |
| 800 | 68 | 71 | 49 | 32 | 18,3 | 27,6 | 32,3 | 41,9 | 447 | 677 | 794 | 1034 |
| | 75 | 78 | 54 | 36 | 17,2 | 25,6 | 29,8 | 38,5 | 419 | 628 | 733 | 949 |
| 1000 | 79 | 82 | 57 | 37 | 20,5 | 30,9 | 36,1 | 46,9 | 501 | 759 | 889 | 1157 |
| | 87 | 91 | 64 | 42 | 19,2 | 28,5 | 33,3 | 42,9 | 469 | 701 | 818 | 1057 |
| 1500 | 87 | 90 | 63 | 41 | 26 | 39 | 45,6 | 59,1 | 636 | 959 | 1123 | 1457 |
| | 97 | 102 | 71 | 46 | 24,2 | 35,8 | 41,6 | 53,6 | 592 | 879 | 1024 | 1318 |

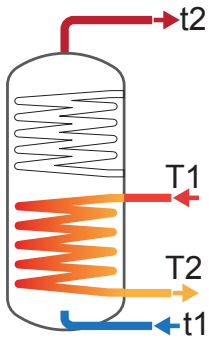

LOWER FIXED HEAT EXCHANGER

| Model | Ignition time (minutes) from 10 °C to t2 and primary at T1 | | | | Maximum power exchange (kW) with primary at T1, secondary within 10-45 °C and constant use of DHW production | | | | DHW continuous production lt/h within 10-45 °C and primary at T1 | | | |
|-------|------------------------------------------------------------|-------|-------|-------|--------------------------------------------------------------------------------------------------------------|------|------|------|------------------------------------------------------------------|------|------|------|
| | T1/t2 | | | | T1 | | | | T1 | | | |
| | 55/50 | 65/60 | 70/60 | 80/60 | 55 | 65 | 70 | 80 | 55 | 65 | 70 | 80 |
| 150 | 99 | 102 | 71 | 46 | 6,6 | 10 | 11,7 | 15,2 | 162 | 246 | 288 | 371 |
| | 111 | 116 | 81 | 53 | 6,1 | 9,1 | 10,6 | 13,2 | 149 | 223 | 260 | 336 |
| 200 | 92 | 95 | 66 | 43 | 9 | 13,5 | 15,8 | 20,5 | 220 | 332 | 389 | 506 |
| | 103 | 107 | 75 | 49 | 8,3 | 12,3 | 14,4 | 18,5 | 203 | 303 | 354 | 456 |
| 300 | 97 | 101 | 70 | 45 | 13,5 | 20,2 | 23,6 | 30,6 | 331 | 498 | 583 | 756 |
| | 106 | 111 | 78 | 51 | 12,5 | 18,5 | 21,5 | 27,5 | 307 | 455 | 529 | 680 |
| 400 | 105 | 110 | 76 | 50 | 16,9 | 25,4 | 29,6 | 38,3 | 416 | 625 | 731 | 947 |
| | 117 | 122 | 86 | 57 | 15,4 | 23,2 | 26,9 | 34,5 | 387 | 571 | 664 | 853 |
| 500 | 111 | 116 | 81 | 53 | 20,2 | 30,1 | 35,1 | 45,3 | 496 | 742 | 867 | 1121 |
| | 126 | 131 | 93 | 61 | 18,7 | 27,3 | 31,7 | 40,6 | 459 | 674 | 782 | 1000 |
| 800 | 116 | 120 | 84 | 55 | 30,3 | 45,4 | 53 | 68,6 | 746 | 1120 | 1309 | 1695 |
| | 131 | 136 | 96 | 64 | 28,2 | 41,4 | 48,1 | 61,6 | 692 | 1021 | 1186 | 1521 |
| 1000 | 114 | 119 | 84 | 56 | 38,9 | 57,9 | 67,5 | 87 | 958 | 1429 | 1667 | 2151 |
| | 132 | 138 | 98 | 65 | 35,5 | 52,2 | 60,4 | 77 | 882 | 1288 | 1492 | 1903 |
| 1500 | 162 | 168 | 119 | 78 | 41 | 61 | 71 | 91,5 | 1009 | 1504 | 1753 | 2261 |
| | 189 | 197 | 139 | 92 | 37,7 | 54,9 | 63,4 | 80,7 | 927 | 1352 | 1564 | 1993 |

| DHW produced in the first 10 minutes in lt/10' input 10 °C output 45 °C, storage at t2 and primary at T1 | | | | DHW produced in the first hour in lt/60' input 10 °C output 45 °C, storage at t2 and primary at T1 | | | | Flow rate | Exchanger pressure loss | |
|----------------------------------------------------------------------------------------------------------------|-------|-------|-------|----------------------------------------------------------------------------------------------------------|-------|-------|-------|-----------|-------------------------|----------|
| T1/t2 | | | | T1/t2 | | | | | [m³/h] | [mm.H₂O] |
| 55/50 | 65/60 | 70/60 | 80/60 | 55/50 | 65/60 | 70/60 | 80/60 | | | |
| 73 | 96 | 101 | 111 | 142 | 201 | 224 | 272 | 2 | 145,90 | 14,31 |
| 72 | 94 | 98 | 107 | 135 | 189 | 210 | 253 | 1 | 40,41 | 3,96 |
| 92 | 121 | 127 | 139 | 179 | 254 | 283 | 343 | 2,5 | 275,70 | 27,04 |
| 90 | 118 | 124 | 135 | 172 | 241 | 267 | 323 | 1,25 | 76,37 | 7,49 |
| 141 | 185 | 194 | 211 | 265 | 373 | 413 | 498 | 3 | 541,01 | 53,06 |
| 139 | 181 | 189 | 205 | 255 | 355 | 393 | 469 | 1,5 | 149,87 | 14,70 |
| 211 | 276 | 288 | 313 | 388 | 544 | 603 | 723 | 3,5 | 1028,24 | 100,84 |
| 208 | 271 | 282 | 304 | 374 | 519 | 572 | 679 | 1,75 | 284,83 | 27,93 |
| 229 | 299 | 311 | 336 | 406 | 567 | 625 | 745 | 3,5 | 1028,24 | 100,84 |
| 227 | 294 | 305 | 327 | 392 | 542 | 595 | 702 | 1,75 | 284,83 | 27,93 |
| 401 | 521 | 541 | 581 | 684 | 950 | 1044 | 1236 | 6 | 911,70 | 89,41 |
| 397 | 513 | 531 | 567 | 662 | 911 | 995 | 1168 | 3 | 252,55 | 24,77 |
| 508 | 657 | 678 | 723 | 825 | 1137 | 1241 | 1456 | 6 | 1025,66 | 100,58 |
| 502 | 647 | 666 | 706 | 799 | 1091 | 1184 | 1376 | 3 | 284,12 | 27,86 |
| 691 | 891 | 919 | 974 | 1094 | 1499 | 1630 | 1897 | 6 | 1310,57 | 128,52 |
| 684 | 878 | 902 | 951 | 1059 | 1435 | 1551 | 1786 | 3 | 363,04 | 35,60 |



| DHW produced in the first 10 minutes in lt/10' input 10 °C output 45 °C, storage at t2 and primary at T1 | | | | DHW produced in the first hour in lt/60' input 10 °C output 45 °C, storage at t2 and primary at T1 | | | | Flow rate | Exchanger pressure loss | |
|----------------------------------------------------------------------------------------------------------------|-------|-------|-------|----------------------------------------------------------------------------------------------------------|-------|-------|-------|-----------|-------------------------|----------|
| T1/t2 | | | | T1/t2 | | | | | [m³/h] | [mm.H₂O] |
| 55/50 | 65/60 | 70/60 | 80/60 | 55/50 | 65/60 | 70/60 | 80/60 | | | |
| 195 | 251 | 258 | 272 | 298 | 407 | 440 | 507 | 2 | 218,85 | 21,46 |
| 193 | 247 | 253 | 266 | 287 | 388 | 418 | 479 | 1 | 60,62 | 5,95 |
| 253 | 325 | 335 | 354 | 392 | 536 | 581 | 675 | 2,5 | 441,12 | 43,26 |
| 250 | 321 | 329 | 346 | 378 | 512 | 553 | 635 | 1,25 | 122,19 | 11,98 |
| 388 | 499 | 513 | 542 | 597 | 814 | 882 | 1021 | 3 | 927,45 | 90,95 |
| 384 | 492 | 504 | 529 | 578 | 780 | 839 | 960 | 1,5 | 256,91 | 25,19 |
| 550 | 706 | 723 | 759 | 814 | 1101 | 1186 | 1359 | 3,5 | 1480,67 | 145,20 |
| 546 | 697 | 712 | 744 | 791 | 1058 | 1133 | 1284 | 1,75 | 410,16 | 40,22 |
| 651 | 834 | 855 | 897 | 965 | 1304 | 1404 | 1607 | 3,5 | 1850,84 | 181,50 |
| 645 | 822 | 840 | 877 | 935 | 1249 | 1336 | 1510 | 1,75 | 512,70 | 50,28 |
| 1026 | 1314 | 1345 | 1410 | 1499 | 2023 | 2174 | 2483 | 6 | 1538,50 | 150,87 |
| 1017 | 1297 | 1325 | 1381 | 1455 | 1944 | 2076 | 2344 | 3 | 426,18 | 41,79 |
| 1345 | 1720 | 1759 | 1840 | 1952 | 2625 | 2815 | 3202 | 6 | 1994,35 | 195,58 |
| 1332 | 1696 | 1730 | 1799 | 1891 | 2512 | 2675 | 3004 | 3 | 552,45 | 54,18 |
| 1870 | 2378 | 2419 | 2504 | 2509 | 3330 | 3530 | 3936 | 6 | 2108,31 | 206,75 |
| 1856 | 2352 | 2388 | 2459 | 2443 | 3209 | 3378 | 3722 | 3 | 584,02 | 57,27 |

BOLLY® 2 ST - PRESSURE LOSS

PRESSURE LOSS - UPPER FIXED HEAT EXCHANGER





| Heat exchanger surface [m ²] | |
|------------------------------------------|-----|
| 150 | 0,4 |
| 200 | 0,5 |
| 300 | 0,7 |
| 400 | 1 |
| 500 | 1 |
| 800 | 1,6 |
| 1000 | 1,8 |
| 1500 | 1,9 |

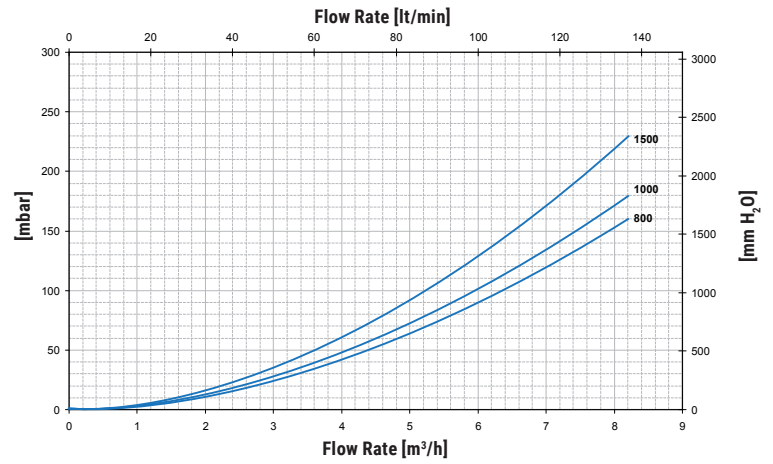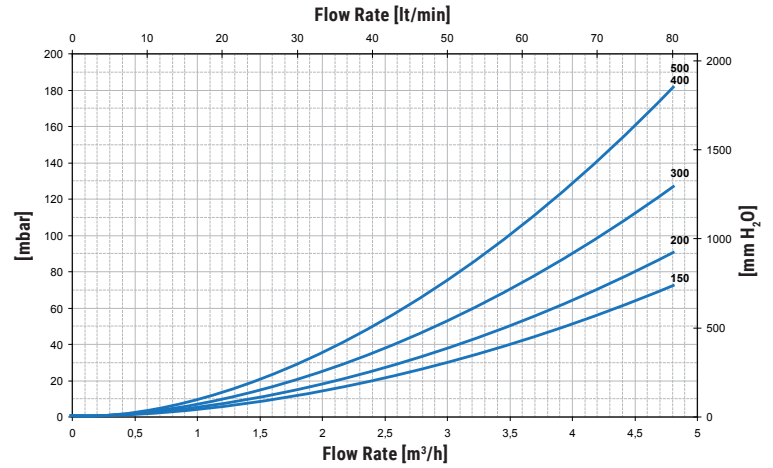

PRESSURE LOSS - LOWER FIXED HEAT EXCHANGER




| Heat exchanger surface [m ²] | |
|------------------------------------------|-----|
| 150 | 0,6 |
| 200 | 0,8 |
| 300 | 1,2 |
| 400 | 1,5 |
| 500 | 1,8 |
| 800 | 2,7 |
| 1000 | 3,5 |
| 1500 | 3,8 |

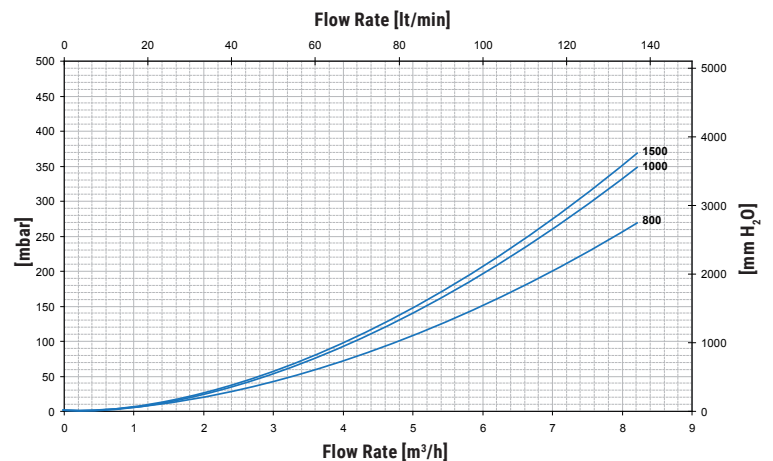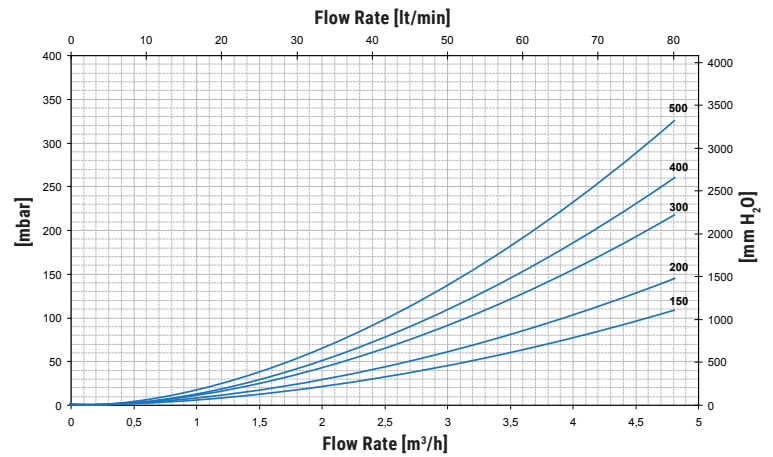


BOLLY® 2 ST - UPPER HEAT EXCHANGER OUTPUT CHART

HEAT EXCHANGER OUTPUT REFERRED TO TEMPERATURE AND FLOW RATE OF PRIMARY CIRCUIT AND WITH SECONDARY AT 10/45°C AT MAXIMUM WITHDRAWAL OF PRODUCIBLE DHW (UPPER LIMIT OF THE CURVES REFERRED TO MAXIMUM PRIMARY FLOW RATE IN THE HEAT EXCHANGER, WHILE THE LOWER LIMIT IN THE CURVE REFERS TO THE MINIMUM PRIMARY FLOW RATE)

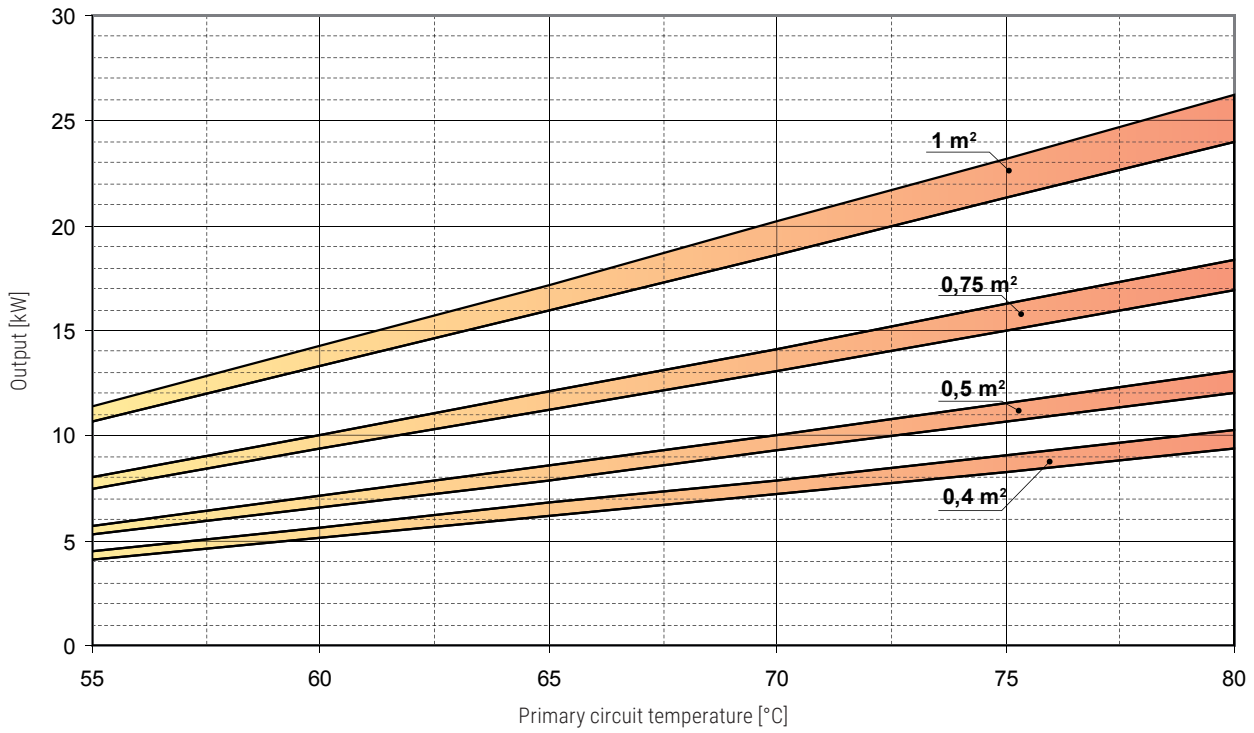

| Heat exchanger surface | 0,4 m ² | | 0,5 m ² | | 0,75 m ² | | 1 m ² | |
|-------------------------------|--------------------|-----|--------------------|------|---------------------|-----|------------------|------|
| Flow rate [m ³ /h] | MAX | MIN | MAX | MIN | MAX | MIN | MAX | MIN |
| | 2 | 1 | 2,5 | 1,25 | 3 | 1,5 | 3,5 | 1,75 |

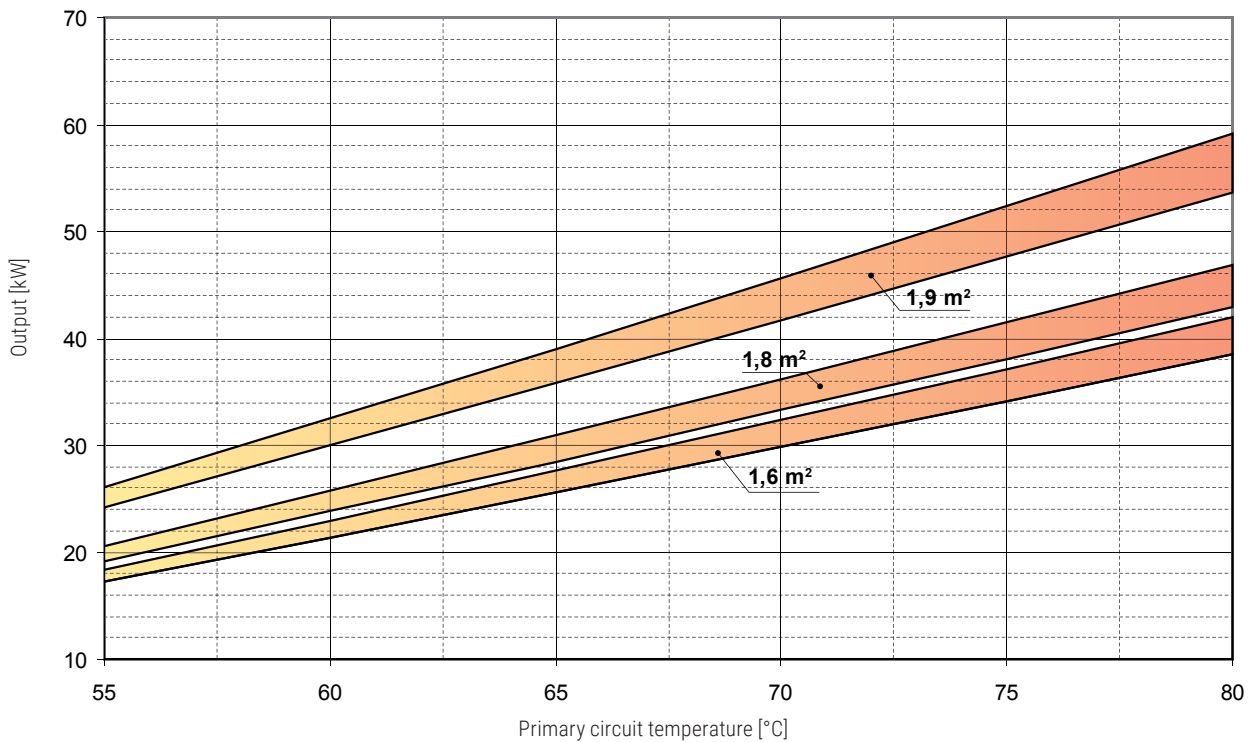

| Heat exchanger surface | 1,6 m ² | | 1,8 m ² | | 1,9 m ² | |
|-------------------------------|--------------------|-----|--------------------|-----|--------------------|-----|
| Flow rate [m ³ /h] | MAX | MIN | MAX | MIN | MAX | MIN |
| | 6 | 3 | 6 | 3 | 6 | 3 |

LOWER HEAT EXCHANGER TECHNICAL DATA - SEE BOLLY® 1 ST